


WASHINGTON AIR NATIONAL GUARD
FOUR LAKES COMMUNICATION STATION, WA

BLDG 203

STATE MAINTENANCE BLDG
950 SF

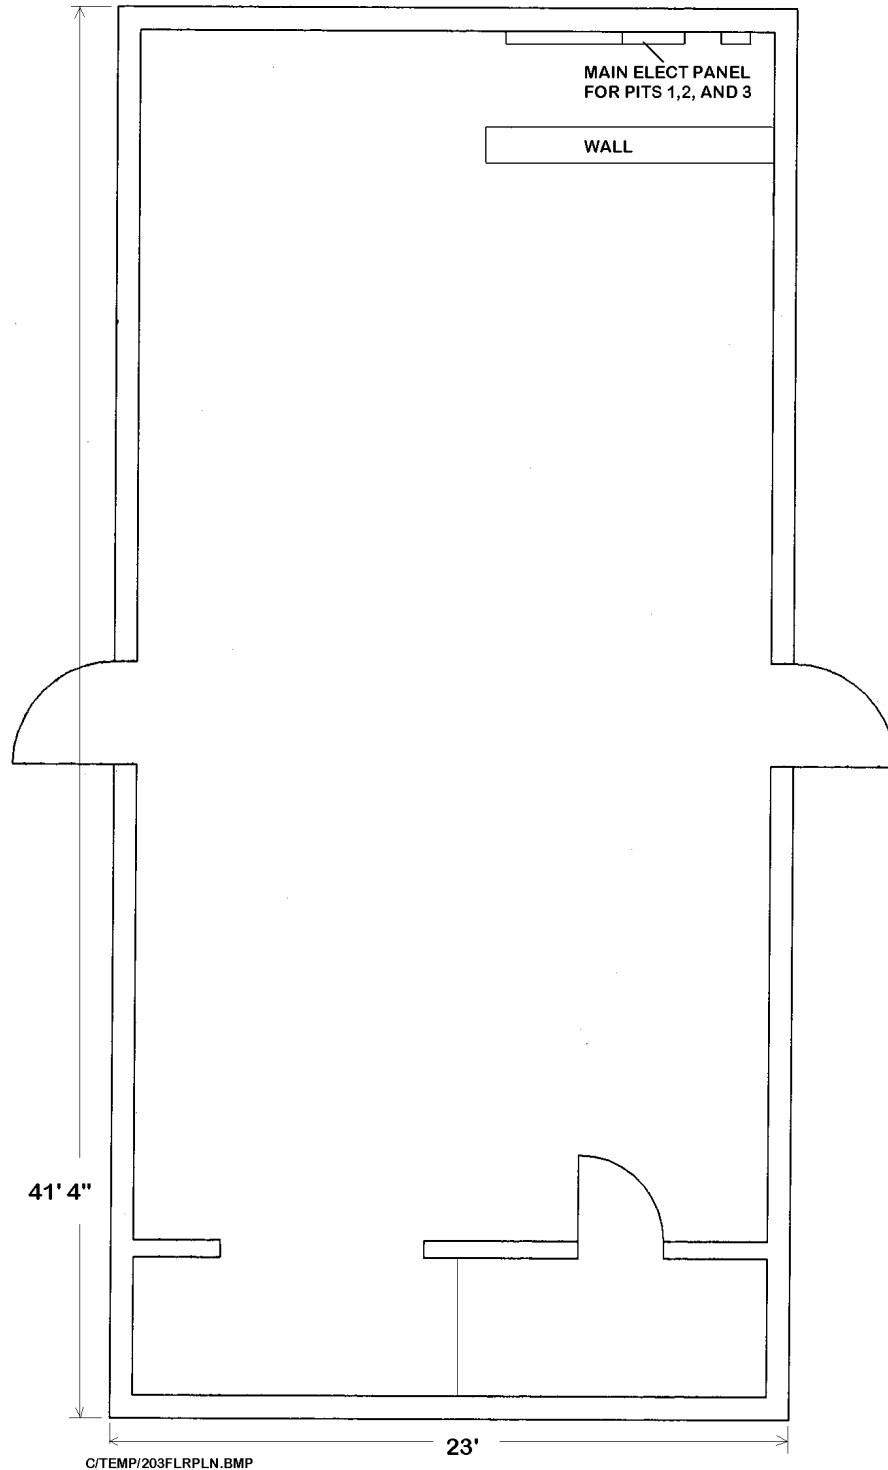

Water shutoff is located in restroom of Bldg 202.